

# Lightning Attachment Models and Maximum Shielding Failure Current: Application to Transmission Lines

Pantelis N. Mikropoulos, *Member, IEEE*, and Thomas E. Tsovilis, *Student Member, IEEE*

**Abstract**— General relationships for the estimation of the maximum shielding failure current of overhead transmission lines have been derived by performing shielding analysis on the basis of several lightning attachment models including a recently introduced statistical one. The interdependence of maximum shielding failure current, transmission line geometry and factors employed in lightning attachment models is discussed through an application to typical 150 kV and 400 kV lines of the Hellenic transmission system. The maximum shielding failure current depends on transmission line geometry and shows a great variability among the lightning attachment models that are used in shielding analysis; electrogeometric models, thus also the IEEE Standard 1243:1997, yield higher values. These results are of great importance when considering that the maximum shielding failure current of transmission lines, besides being employed in estimating their shielding failure flashover rate, is an important parameter for insulation coordination studies.

**Index Terms**— Direct stroke shielding, lightning, maximum shielding failure current, transmission lines.

## I. INTRODUCTION

LIGHTNING is the main cause of overhead transmission line outages affecting reliability of power supply thus, consequently, resulting in economic losses. Therefore, shielding against direct lightning strokes to phase conductors of transmission lines is provided by shield wires, which are metallic elements that are able to, by physical means, launch a connecting upward discharge that intercepts the descending lightning leader from a distance called striking distance. Thus, the lightning current is conducted through the towers and dispersed by ground electrodes into earth.

The shielding design of transmission lines, that is the appropriate positioning of shield wires with respect to phase conductors, can be achieved by implementing electrogeometric models [1], representative of their application is the method suggested by IEEE Standard 1243:1997 [2], which assume the striking distance to be solely a function of the prospective stroke current [3]–[15]. Alternatively, shielding design may be realized by employing models based on more solid physical ground of lightning attractiveness [16]–[25], called hereafter, in accordance with Waters [26], generic models. Recently a statistical approach in shielding design has

been introduced [27], [28] by implementing a statistical lightning attachment model derived from scale model experiments [29].

A perfect shielding of transmission lines is achieved when lightning strokes possessing peak current greater than the critical current, which causes flashover of insulation, are intercepted. Apparently, some of the less intense strokes may not be intercepted by the shield wires and strike to phase conductors, however these are not expected to cause flashover. In practice, economical shielding design of transmission lines is realized based on an acceptable shielding failure flashover rate. Hence, there is a range of currents of lightning strokes terminating at the phase conductors which may cause flashover. Although the lower limit of this range, that is, the critical current can be estimated based on the geometrical and electrical characteristics of the transmission line [2], the upper limit, called maximum shielding failure current, requires extensive geometrical analysis depending on the lightning attachment model used for shielding analysis. The maximum shielding failure current of a transmission line is used in calculations of the expected shielding failure flashover rate of the line, and it is an important parameter in insulation coordination studies; for example when studying the insulation performance of the equipment of a high voltage substation it may be considered as the upper limit of all possible lightning stroke currents impinging to the substation entrance.

For a given transmission line geometry the maximum shielding failure current has been formulated on the basis of electrogeometric models in [30] and [31]. The present work provides general expressions for the calculation of the maximum shielding failure current on the basis of generic models as there was a lack of such formulation in literature. It also introduces a simple formula for maximum shielding failure current calculations by implementing the statistical lightning attachment model [29].

The interdependence of maximum shielding failure current, transmission line geometry and factors employed in lightning attachment models is discussed. It is shown that for a given transmission line geometry there is a great variability in maximum shielding failure current among models; electrogeometric models, thus also IEEE Standard [2], yield higher values. These findings are discussed and further elucidated through an application to typical 150 kV and 400 kV overhead lines of the Hellenic transmission system.

---

P. N. Mikropoulos (e-mail: pnm@eng.auth.gr) and Th. E. Tsovilis (e-mail: thtsovil@auth.gr) are with the Department of Electrical Energy, School of Electrical and Computer Engineering, Aristotle University of Thessaloniki, Thessaloniki, 54124 Greece.

## II. MAXIMUM SHIELDING FAILURE CURRENT FORMULATION BASED ON DIFFERENT LIGHTNING ATTACHMENT MODELS

### A. Electrogeometric models

Electrogeometric models have historically been employed in transmission line shielding providing acceptable protection against direct lightning strokes to phase conductors and they are still widely used [2]. The application of these models in shielding design is based on striking distance, which is defined as the distance between the descending lightning leader and the struck object at which the upward connecting discharge is initiated. Striking distance to an object,  $S$ , is solely related to the prospective lightning peak current and can be associated to striking distance to earth surface,  $D$ , by using a factor  $\gamma$  as

$$S = AI^B = \gamma D \quad (1)$$

where  $I$  (kA) is the prospective lightning peak current and  $S$  and  $D$  are in meters. Factors  $A$ ,  $B$  and  $\gamma$  are given in Table I.

The implementation of electrogeometric models in shielding analysis of transmission lines is described based on Fig. 1 as follows. For a design lightning peak current,  $I_d$ , the striking distances to shield wires and phase conductors,  $S$ , and to earth surface,  $D$ , are calculated according to (1) and Table I. Following, arcs of radii  $S$  are drawn from the shield wires and phase conductors; also, a line parallel to earth surface is drawn at a height  $D$ . According to the electrogeometric models, a descending lightning leader which reaches the arc between M and N will strike to the phase conductor, hence a shielding failure width,  $W$ , is defined (Fig. 1). With increasing  $I_d$  the shielding failure width decreases, thus there is a critical design current which corresponds to  $W = 0$ , hereafter called maximum shielding failure current,  $I_{MSF}$ .

For a given transmission line geometry, thus also shielding angle  $\alpha$ , geometrical analysis similar to that conducted in [31] yields the following relation as a good approximation of  $I_{MSF}$

$$I_{MSF} = \left[ \frac{\gamma(h_m + h_p)/2}{A(1 - \gamma \sin \alpha)} \right]^{\frac{1}{B}} \quad (2)$$

where  $I_{MSF}$  is in kA, factors  $A$ ,  $B$ ,  $\gamma$  are given in Table I and  $h_m$  (m),  $h_p$  (m) and  $\alpha$  are defined in Fig. 1. From (2) it can be deduced that  $I_{MSF}$  increases with increasing transmission line height, factor  $\gamma$  and shielding angle but decreases with increasing factors  $A$  and  $B$ , that is with increasing striking distance for a fixed lightning peak current.

Despite their simplicity and widespread applicability, the electrogeometric models, with the only exception of [4], do not consider the effects of the struck object height on striking distance  $S$ . Also, most models employ in (1) a constant value for factor  $\gamma$  (Table I); however, as was discussed in detail in [29],  $\gamma$  should depend on struck object height, lightning peak current and interception probability (i.e. the probability for a connecting upward discharge emerging from the air terminal).

TABLE I

FACTORS  $A$ ,  $B$  AND  $\gamma$  TO BE USED IN (1)

Electrogeometric model	$A$	$B$	$\gamma$
Wagner & Hileman [3]	14.2	0.42	1
Young et al. [4]	$\gamma 27$	0.32	1 for $h < 18$ m $\frac{444}{462-h}$ for $h > 18$ m $h$ the shield wire height
Armstrong & Whitehead [6]	6.72	0.80	1.11
Brown & Whitehead [7]	7.1	0.75	1.11
Whitehead [9]	9.4	0.67	1
Love [11]	10	0.65	1
Suzuki [32] derived from Golde [33]	3.3	0.78	1
Anderson [12], IEEE WG [13]	8	0.65	$1/\beta^*$
IEEE Std 1243 [2]	10	0.65	$1/\beta^{**}$

\*  $\beta = 0.64$  for UHV lines, 0.8 for EHV lines, and 1 for other lines  
 \*\*  $\beta = 0.36 + 0.17 \ln(43-h)$ , for  $h < 40$  m,  $\beta = 0.55$  for  $h > 40$  m where  $h$  is the phase conductor height

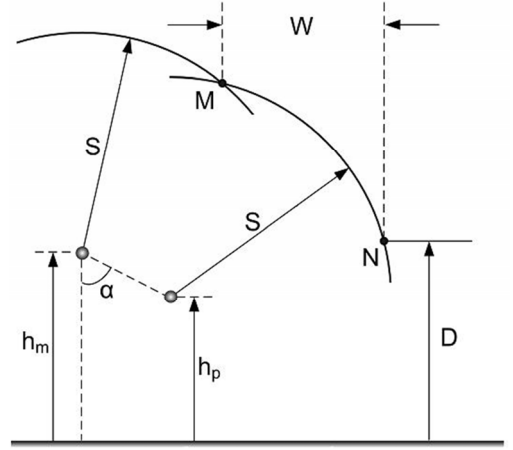


Fig. 1. Shielding analysis according to electrogeometric models.  $h_m$  shield wire height;  $h_p$  phase conductor height;  $\alpha$  shielding angle;  $S$  striking distance to shield wire and phase conductor;  $D$  striking distance to earth surface;  $W$  shielding failure width.

### B. Eriksson's model.

Eriksson [16], based on field data and by using the Carrara and Thione [34] critical radius concept for an upward leader inception criterion, modified the electrogeometric model by introducing the attractive radius in shielding design, defined as the "capture" radius at which the upward and downward leader intercept. The attractive radius,  $R$ , of a shield wire or phase conductor, is expressed as a function, besides lightning peak current, of its height,  $h$ , as

$$R = 0.67 h^{0.6} I^{0.74} \quad (3)$$

where  $I$  (kA) is the prospective lightning peak current and  $h$  and  $R$  are in meters.

Eriksson, performing a shielding analysis similar to that of the electrogeometric models, employed the attractive radius to draw arcs from the shield wire and phase conductor up to the phase conductor height, as shown in Fig. 2.

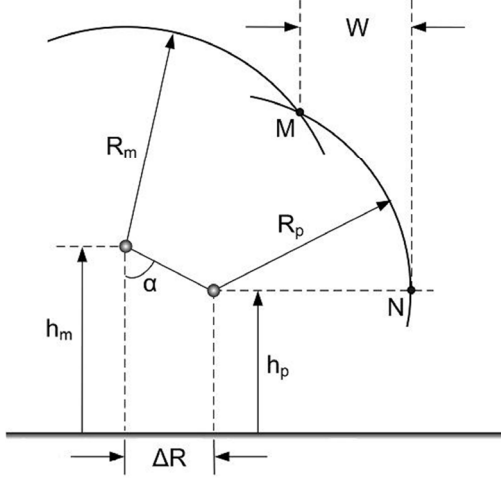


Fig. 2. Shielding analysis according to Eriksson's electrogeometric model.  $\alpha$  shielding angle;  $h_m$ ,  $h_p$  height of shield wire and phase conductor, respectively;  $R_m$ ,  $R_p$  attractive radius of shield wire and phase conductor, respectively;  $W$  shielding failure width;  $\Delta R$  horizontal separation distance between shield wire and phase conductor.

Based on a geometrical analysis similar to that conducted in [31], for shielding failure width  $W = 0$  (Fig. 2), the maximum shielding failure current  $I_{MSF}$  (kA) can be expressed as

$$I_{MSF} = \left[ \frac{\Delta R + \sqrt{\Delta R^2 + \Psi^2(\Gamma^2 - 1)}}{0.67 h_p^{0.6}(\Gamma^2 - 1)} \right]^{\frac{1}{0.74}} \quad (4)$$

where  $\Gamma = (R_m/R_p) = (h_m/h_p)^{0.6}$ ,  $\Psi^2 = (h_m - h_p)^2 + \Delta R^2$  and  $\Delta R$  (m),  $h_m$  (m) and  $h_p$  (m) are defined in Fig. 2. From (4) it can be deduced that  $I_{MSF}$  increases with increasing transmission line height and shielding angle; these effects are in accordance with those deduced for the electrogeometric models.

### C. Generic models

Following Eriksson's work [16], physical models for lightning attachment that consider also the inception of the upward connecting discharge emerging from the prospective struck object were developed [17]-[25]. Thus, based on different leader inception criteria, expressions of striking distance or attractive radius which take into account, besides lightning parameters, prospective struck object height were derived. The following general expression can be used to estimate the attractive radius of an object,  $R$ , defined as the longest lateral distance from the object where lightning attachment occurs

$$R = \xi h^E I^F \quad (5)$$

where  $R$  is in meters,  $I$  (kA) is the prospective lightning peak current,  $h$  (m) the struck object height and factors  $\xi$ ,  $E$  and  $F$  are listed in Table II according to different authors.

Following a shielding analysis similar to that of Rizk [18], a shielding failure will occur when the descending lightning leader enters the shielding failure width  $W$  (Fig. 3), given as

TABLE II  
FACTORS  $\xi$ ,  $E$  AND  $F$  TO BE USED IN (5)

Generic model	$\xi$	$E$	$F$
Rizk [18]	1.57	0.45	0.69
Petrov et. al. [22]*	0.47	0.67	0.67
S. Ait-Amar & Berger [25]	3	0.20	0.67

\* using as  $h$  in (5) the object height plus 15 m.

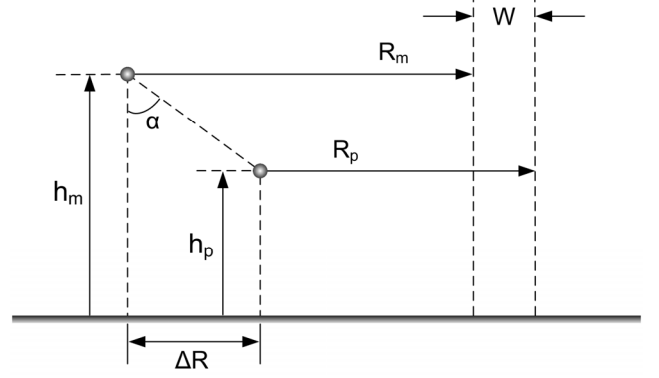


Fig. 3. Shielding analysis according to generic models. Definitions of symbols are in accordance to Fig. 2.

$$W = R_p + \Delta R - R_m \quad (6)$$

Thus, for a given transmission line geometry the lightning peak current corresponding to  $W = 0$  is the maximum shielding failure current. With the aid of (5) and (6)  $I_{MSF}$  is formulated as

$$I_{MSF} = \left[ \frac{\Delta R}{\xi(h_m^E - h_p^E)} \right]^{\frac{1}{F}} = \left[ \frac{(h_m - h_p) \tan \alpha}{\xi(h_m^E - h_p^E)} \right]^{\frac{1}{F}} \quad (7)$$

where  $I_{MSF}$  is in kA, factors  $\xi$ ,  $E$ , and  $F$  are given in Table II and  $\Delta R$  (m),  $\alpha$ ,  $h_m$  (m) and  $h_p$  (m) are defined in Fig. 3. When applying Petrov et al. model [22] in (7)  $h_m$ ,  $h_p$  are the heights of the shield wire and phase conductor, respectively, plus 15 m. From (7) it can be deduced that  $I_{MSF}$  increases with increasing transmission line height and shielding angle but it decreases with increasing factors  $\xi$ ,  $E$  and  $F$ , that is with increasing attractive radius of an air terminal for a fixed lightning peak current; these effects are in accordance with those deduced by employing the electrogeometric models in shielding analysis (Subsection II.A).

It must be mentioned that the attractive radius equations given in [22] and [25] do not refer to the transmission line geometry; however, employing these models to calculate the maximum shielding failure current in transmission lines may provide useful information concerning their applicability. Models [17]-[25], including Eriksson's [16], have added significant value in knowledge of lightning attachment. However, as was discussed in [27], their implementation in shielding design suffers from not considering lightning interception probability.

#### D. Statistical model

Lightning attachment is a stochastic phenomenon, thus the most commonly employed parameters in shielding design, namely striking distance and attractive radius, should be considered as statistical quantities varying, besides struck object height and lightning stroke current, with interception probability. Their dependence upon interception probability is not considered in (1) and (5) which may attribute to the statistical behavior of striking distance and attractive radius, respectively, only through the lightning stroke current distribution.

Implementation in shielding design of a distribution for the striking distance using a mean value and a fixed standard deviation was made in [8]-[10]. Recently, investigations on the interception probability of an air terminal through scale model experiments made possible the formulation of distributions for striking distance and interception radius [29], [35] and thus a statistical approach in shielding design has been proposed [27], [36]. The interception radius is considered as statistical quantity with a mean value, referring to 50% interception probability, called critical interception radius,  $R_{ci}$ , and a standard deviation  $\sigma$ . It is given with reference to the striking distance to earth surface as

$$\left( \frac{R_{ci}}{D}, \sigma \right) = c_1 \ln \left( \frac{h}{D} \right) + c_2 \quad (8)$$

where  $R_{ci}$  is in meters,  $h$  (m) is the struck object height and  $D$  (m) is the striking distance to earth surface. The coefficients  $c_1$  and  $c_2$ , and  $\sigma$  in formula form are given in Table III [29]:

TABLE III  
COEFFICIENTS  $c_1$ ,  $c_2$  AND EXPRESSION OF  $\sigma$  TO BE USED IN (8)

Positive Lightning			Negative Lightning		
$c_1$	$c_2$	$\sigma\%$	$c_1$	$c_2$	$\sigma\%$
0.235	0.90	$1.9(h/D)^{-0.75}$	0.272	1.24	$5.0(h/D)^{-0.43}$

Equation (8) can be used for shielding analysis by using a known relation between striking distance to earth surface,  $D$ , and lightning peak current commonly expressed as  $D = A'I^{B'}$ . Thus, based on Fig. 3 and by using the critical interception radii of shield wire and phase conductor as calculated from (8), the shielding failure width  $W$  at critical interception is

$$W = c_1 D \ln(h_p/h_m) + \Delta R \quad (9)$$

and  $I_{MSF}$  at critical interception is formulated as

$$I_{MSF} = \left[ \frac{\Delta R}{A'c_1 \ln(h_m/h_p)} \right]^{\frac{1}{B'}} = \left[ \frac{(h_m - h_p) \tan \alpha}{A'c_1 \ln(h_m/h_p)} \right]^{\frac{1}{B'}} \quad (10)$$

where  $I_{MSF}$  is in kA,  $\Delta R$  (m),  $\alpha$ ,  $h_m$  (m) and  $h_p$  (m) are defined in Fig. 3 and  $c_1$  is given in Table III. From (10) it can be de-

duced that  $I_{MSF}$  increases with increasing transmission line height and shielding angle but it decreases with increasing factors  $A'$  and  $B'$ , that is with increasing striking distance to earth surface for a fixed lightning peak current; these effects are in accordance with those deduced by employing the electrogeometric and generic models in shielding analysis (Subsections II.A-II.C). Adopting from [11] the values of 10 and 0.65 for factors  $A'$  and  $B'$ , respectively, (10) becomes for negative lightning

$$I_{MSF} = \left[ \frac{\Delta R}{2.72 \ln(h_m/h_p)} \right]^{\frac{1}{0.65}} \quad (11)$$

and this equation, which refers to critical interception, is used hereafter for maximum shielding failure current calculations.

It is important to note that for a given transmission line geometry the interception radii  $R_m$ ,  $R_p$  are statistical quantities; they vary, besides lightning stroke current, with interception probability according to (8). Therefore also the shielding failure width, as given by (6), is accordingly statistically distributed indicating a non-deterministic value for  $I_{MSF}$ ; work on this subject is in progress.

#### III. CALCULATION OF MAXIMUM SHIELDING FAILURE CURRENT IN TRANSMISSION LINES

Fig. 4 shows the maximum shielding failure current as a function of shielding angle, calculated by employing the lightning attachment models described in Section II. This is demonstrated for an appropriate shielding angle range of typical 400 kV double-circuit lines of the Hellenic transmission system. It is obvious that there is a great variability in  $I_{MSF}$  among lightning attachment models, however, all models predict an increase of  $I_{MSF}$  with increasing shielding angle; the latter is in accordance with results obtained through simulation [37], [38]. Also, as a general result, the electrogeometric models, thus also IEEE Std [2], yield higher values of  $I_{MSF}$  than the generic, Eriksson's and the statistical model.

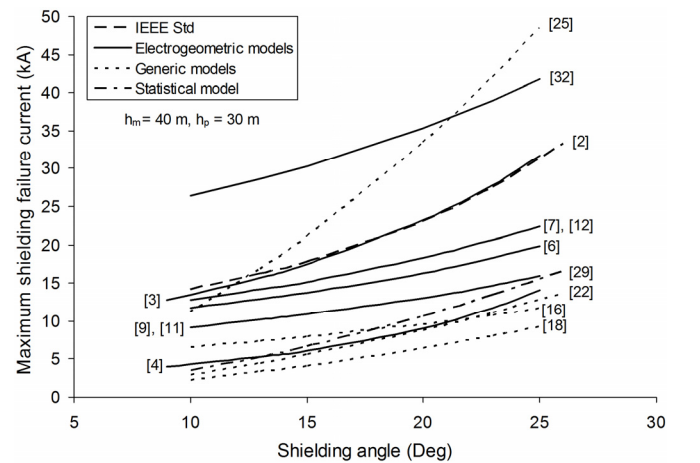


Fig. 4. Maximum shielding failure current,  $I_{MSF}$ , as a function of shielding angle.

The variability in  $I_{MSF}$  among lightning attachment models can also be deduced from the results shown in Tables IV-VI referring to typical 150 kV and 400 kV lines of the Hellenic transmission system; tower geometries are shown in Fig. 5. These calculations refer to line geometries corresponding to the tower and to the middle of the span between towers by considering sags of 5.5 m and 8.6 m for the shield wire and phase conductor, respectively. The shielding effect provided, besides shield wire, by the phase conductors in the double-circuit lines has been considered. Thus, reasonably, the lowest  $I_{MSF}$  values are found for the lower phase conductor (Tables V and VI). According to the generic models the lower phase conductor is effectively shielded ( $W < 0$ ) against all prospective lightning stroke currents due to the negative shielding angle provided by the middle phase conductor. The same is also true for the statistical model [29] when referring to critical interception (11); however, when considering  $W$  statistically distributed the statistical model may yield values of  $I_{MSF}$  for the lower phase conductor in accordance with the electro-geometric models. Also, from Tables IV-VI it is obvious that all models yield lower  $I_{MSF}$  values at midspan than at the tower as a result of reduced both height and shielding angle in the former case; this can also be deduced from simulation results [37], [38]. Thus,  $I_{MSF}$  varies along the length of the line.

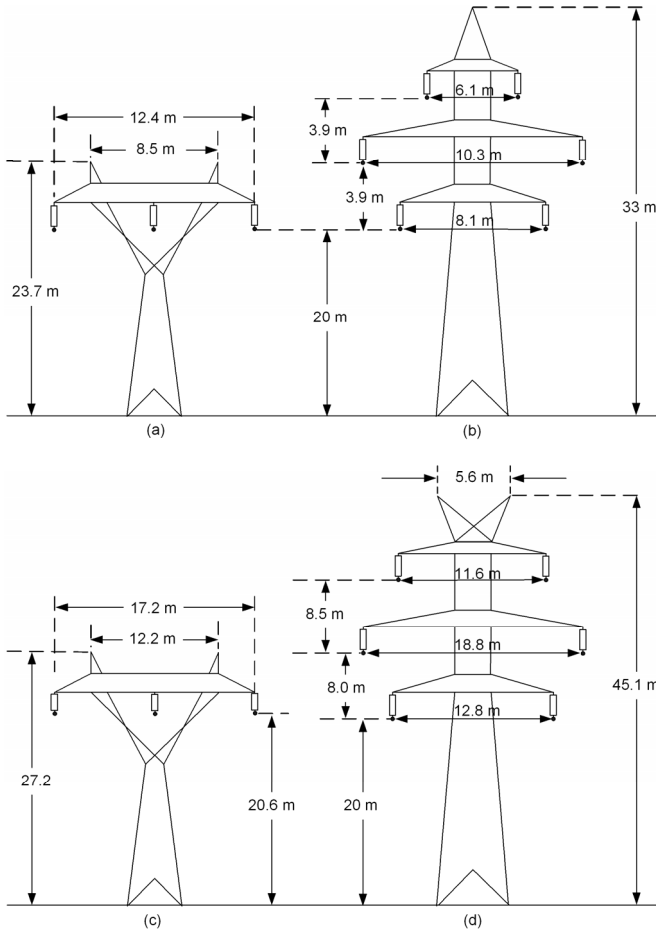


Fig. 5. Typical towers of the 150 kV (a), (b) and 400 kV (c), (d) lines of the Hellenic transmission system.

TABLE IV  
MAXIMUM SHIELDING FAILURE CURRENT (kA) OF 150 kV AND 400 kV SINGLE-CIRCUIT TRANSMISSION LINES

Lightning attachment model	150 kV		400 kV	
	Tower	Midspan	Tower	Midspan
Wagner & Hileman [3]	12.0	2.4	9.8	3.0
Young et al. [4]	3.6	0.4	2.8	0.6
Armstrong & Whitehead [6]	12.1	4.8	10.4	5.4
Brown & Whitehead [7]	13.3	5.0	11.3	5.6
Whitehead [9]	8.8	3.2	7.7	3.7
Love [11]	8.5	3.0	7.5	3.5
Suzuki [32] derived from [33]	24.8	10.3	22.2	11.7
Anderson [12], IEEE WG [13]	12.0	4.2	18.7	7.9
IEEE Std 1243 [2]	12.0	3.4	10.0	3.9
Eriksson [16]	9.1	6.2	8.0	7.0
Rizk [18]	7.4	2.3	5.1	2.2
Petrov et. al. [22]	12.8	4.7	8.3	4.2
Ait-Amar & Berger [25]	32.2	8.1	22.5	8.1
Mikropoulos & Tsovilis [29]	8.9	1.9	6.3	2.0

TABLE V  
MAXIMUM SHIELDING FAILURE CURRENT (kA) OF 150 kV DOUBLE-CIRCUIT TRANSMISSION LINE

Lightning attachment model	Tower			Midspan
	Upper phase	Middle phase	Lower Phase	Upper phase
Wagner & Hileman [3]	34.0	17.7	1.6	9.2
Young et al. [4]	15.5	6.2	0.2	2.6
Armstrong & Whitehead [6]	21.7	14.8	3.6	10.1
Brown & Whitehead [7]	24.7	16.5	3.6	11.0
Whitehead [9]	16.9	11.2	2.9	7.5
Love [11]	16.8	11	2.3	7.2
Suzuki [32] derived from [33]	43.4	30.5	8.3	21.5
Anderson [12], IEEE WG [13]	23.6	15.5	3.3	10.2
IEEE Std 1243 [2]	33.6	17.2	2.6	9.4
Eriksson [16]	12.7	9.7	1.3	8.5
Rizk [18]	11.9	8.4	-	5.0
Petrov et. al. [22]	17.8	13.4	-	8.2
Ait-Amar & Berger [25]	59.8	39.0	-	21.7
Mikropoulos & Tsovilis [29]	18.5	11.4	-	6.0

TABLE VI  
MAXIMUM SHIELDING FAILURE CURRENT (kA) OF 400 kV DOUBLE-CIRCUIT TRANSMISSION LINE

Lightning attachment model	Tower			Midspan
	Upper phase	Middle phase	Lower Phase	Upper phase
Wagner & Hileman [3]	32.0	22.9	1.7	15.5
Young et al. [4]	14.0	8.9	0.3	5.2
Armstrong & Whitehead [6]	19.2	16.5	3.7	12.9
Brown & Whitehead [7]	21.7	18.5	3.8	14.2
Whitehead [9]	16.2	13.2	2.6	10.3
Love [11]	16.1	13.0	2.4	10.1
Suzuki [32] derived from [33]	41.9	35.0	8.7	28.5
Anderson [12], IEEE WG [13]	39.1	33.7	4.4	22.1
IEEE Std 1243 [2]	44.0	22.2	2.7	15.3
Eriksson [16]	9.3	10.2	2.3	8.2
Rizk [18]	6.9	7.2	-	3.8
Petrov et. al. [22]	8.8	9.8	-	5.2
Ait-Amar & Berger [25]	37.8	38.0	-	18.9
Mikropoulos & Tsovilis [29]	12.7	11.9	-	5.9

Fig. 6 shows the maximum shielding failure current of the 150 kV and 400 kV transmission lines calculated by using the average heights of the shield wire and phase conductor along the line, that is, the height at the tower minus two-thirds of the midspan sag. In accordance with the results in Tables IV-VI,

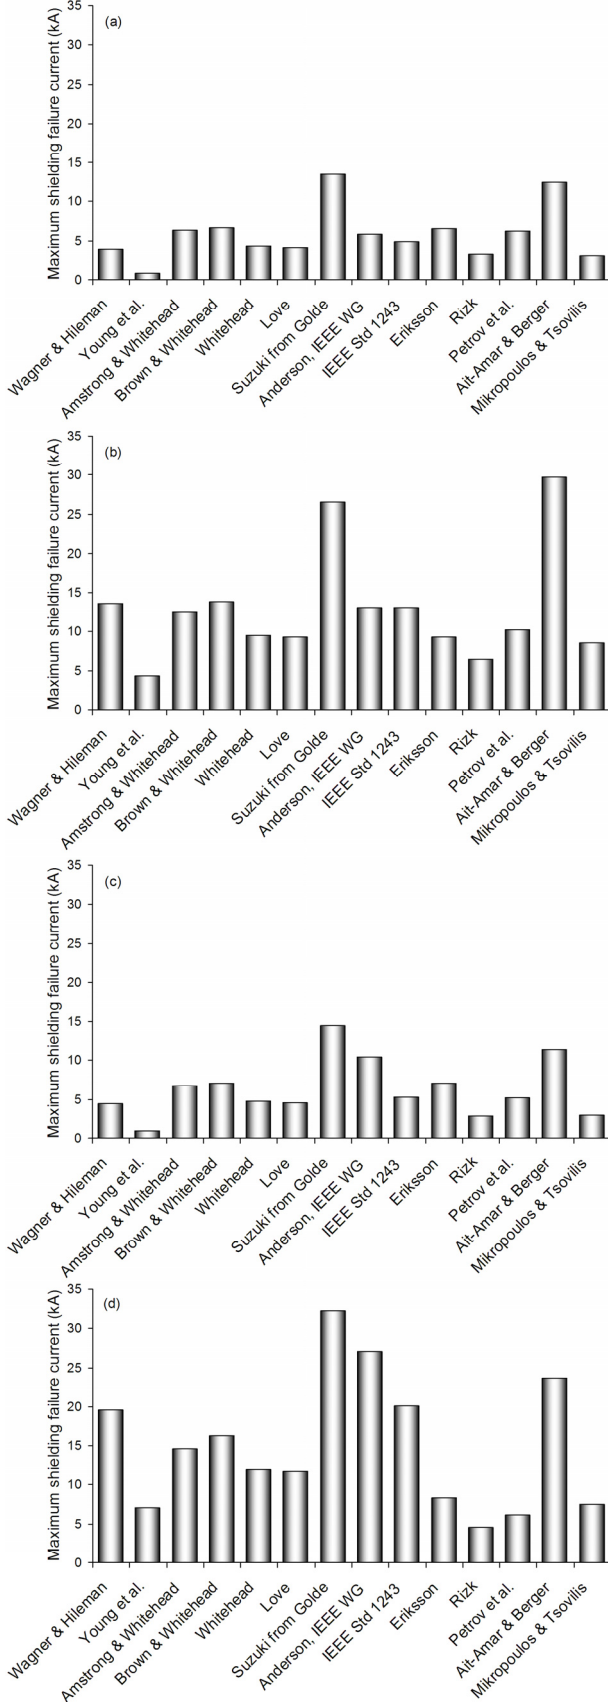


Fig. 6. Maximum shielding failure current of typical single-circuit 150 kV (a), double-circuit 150 kV (b), single-circuit 400 kV (c) and double-circuit 400 kV (d) lines of the Hellenic transmission system.

there is a great variability in  $I_{MSF}$  among models and the electrogeometric models yield higher values of  $I_{MSF}$  than the generic, Eriksson's and the statistical model; this is more obvious for the 400 kV double-circuit transmission line (Fig. 6d). Finally, the lower  $I_{MSF}$  values found for the single-circuit (Figs. 6a and 6c) than the double-circuit lines (Figs. 6b and 6d) indicate a better shielding performance for the former lines.

#### IV. DISCUSSION

The maximum shielding failure current determines the number of strokes per unit time that terminate at the phase conductors of a transmission line as a result of shielding failures. Based on [2], the shielding failure rate of a transmission line,  $SFR$  (shielding failures/100km/year), can be calculated as

$$SFR = 0.2 N_g \int_0^{I_{MSF}} W(I) f(I) dI \quad (12)$$

where  $N_g$  (flashes/km<sup>2</sup>/year) is the ground flash density,  $f(I)$  is the probability density function of the stroke current amplitude distribution and  $W$  is the shielding failure width in meters. However, a shielding failure current may not necessarily cause flashover of insulation; the minimum lightning current causing flashover, termed critical current,  $I_c$  (kA), is given as

$$I_c = \frac{2(CFO)}{Z_s} [2] \quad (13)$$

where CFO (kV) is the critical lightning impulse flashover voltage of the insulation and  $Z_s$  ( $\Omega$ ) is the conductor surge impedance under corona, both as defined in [2].

Following, the shielding failure flashover rate of a transmission line,  $SFFOR$  (flashovers/100km/year), normally used together with backflashover rate to estimate the expected outage rate of a transmission line, is given as

$$SFFOR = 0.2 N_g \int_{I_c}^{I_{MSF}} W(I) f(I) dI \quad (14)$$

Both  $SFR$  and  $SFFOR$  depend upon striking distance and interception radius since the latter shielding design parameters determine  $I_{MSF}$  and  $W$  used in (12) and (14). However, depending on transmission line geometry, the striking distance and interception radius of the shield wire may be affected by the presence of the neighboring phase conductor; this was raised by Peterson and Eriksson [39] in [18] and discussed in detail in [28] and [40]. In fact, the competing upward discharge from a neighboring phase conductor, modifying the extent of development of the connecting upward discharge from the shield wire, may result in a reduction of the striking distance and interception radius of the shield wire. Such an effect on the striking distance or interception radius of the shield wire would reasonably result in higher  $I_{MSF}$  and wider  $W$ , therefore also in bigger  $SFR$  and  $SFFOR$ .

Finally, the maximum shielding failure current, besides employed in estimations of the *SFFOR* of transmission lines, is an important parameter in insulation coordination studies. For example, when studying the insulation performance of the equipment of a high voltage substation it may be considered as the upper limit of all possible lightning stroke currents impinging to the substation entrance. Work on the implications of the variability of  $I_{MSF}$  among lightning attachment models in insulation coordination of substations is in progress.

It must be noted that the present analysis refers to overhead transmission lines on flat ground therefore any effects of topography on maximum shielding failure current calculations have not been taken into account.

## V. CONCLUSIONS

General relationships for the estimation of the maximum shielding failure current of overhead transmission lines have been derived by performing shielding analysis on the basis of several lightning attachment models. The maximum shielding failure current depends on transmission line geometry therefore also it varies along the length of the line. For a fixed transmission line geometry there is a great variability in maximum shielding failure current among lightning attachment models; electrogeometric models, thus also the IEEE Standard 1243:1997, yield higher values. Maximum shielding failure current calculations have been performed for typical 150 kV and 400 kV overhead lines of the Hellenic transmission system; single-circuit lines appear to have a better shielding performance than double-circuit lines. This work provides the means to easily calculate the maximum shielding failure current which, besides being employed in estimating the shielding failure flashover rate of overhead transmission lines, is an important parameter for insulation coordination studies.

## VI. ACKNOWLEDGEMENT

Th. E. Tsovilis wishes to thank the Research Committee of Aristotle University of Thessaloniki for the support provided by a merit scholarship.

## VII. REFERENCES

- [1] R. H. Golde, *Lightning Protection*. London U.K.: Academic Press, 1977, vol. 2, pp. 545-564.
- [2] *IEEE Guide for improving the Lightning performance of Transmission Lines*, IEEE Std. 1243-1997, Dec. 1997.
- [3] C. F. Wagner and A. R. Hileman, "The lightning stroke-II," *AIEE Trans. PA&S*, pp. 622-642, Oct. 1961.
- [4] F. S. Young, J. M. Clayton and A. R. Hileman, "Shielding of transmission lines," *IEEE Trans. Power App. Syst.*, vol. S82, no. 4, pp. 132-154, 1963.
- [5] C. F. Wagner, "Lightning and transmission lines," *Journal of The Franklin Institute*, vol. 283, no. 6, Jun. 1967.
- [6] H. R. Armstrong and E. R. Whitehead, "Field and analytical studies of transmission line shielding," *IEEE Trans. Power App. Syst.*, vol. 87, pp. 270-281, Jan. 1968.
- [7] G. W. Brown and E. R. Whitehead, "Field and analytical studies of transmission line shielding-II," *IEEE Trans. Power App. Syst.*, vol. 88, pp. 617-626, May 1969.
- [8] D. W. Gilman and E. R. Whitehead, "The mechanism of lightning flash-over on high-voltage and extra-high-voltage transmission lines," *Electra*, vol. 27, pp. 65-96, 1973.
- [9] E. R. Whitehead, "CIGRE survey of the lightning performance of EHV transmission lines," *Electra*, vol. 33, pp. 63-89, 1974.
- [10] L. D. Darveniza, F. Popolansky and E. R. Whitehead, "Lightning protection of UHV lines," *Electra*, vol. 41, pp. 39-69, 1975.
- [11] E. R. Love, "Improvements in lightning stroke modeling and applications to design of EHV and UHV transmission lines," M.Sc. thesis, Univ. Colorado, Denver, CO, 1973.
- [12] J. G. Anderson, "Transmission Line Reference Book – 345 kV and Above," Second Edition, 1982, chapter 12, Electric Power Research Institute, Palo Alto, California.
- [13] IEEE Working Group, "A Simplified method for estimating lightning performance of transmission lines," *IEEE Trans. Power App. Syst.*, vol. PAS-104, no. 4, pp. 919-932, Apr. 1985.
- [14] A. M. Mousa and K. D. Srivastava, "A revised electrogeometric model for the termination of lightning strokes on ground objects," in *Proc. Int. Aerosp. Ground Conf. Lightning and Static Electricity*, Oklahoma City, Oklahoma, USA, 1988, pp. 324-352.
- [15] A. M. Mousa and K. D. Srivastava, "Modelling of power lines in lightning incidence calculations," *IEEE Trans. Power Del.*, vol. 5, no. 1, pp. 303-310, Jan. 1981.
- [16] A. J. Eriksson, "An improved electrogeometric model for transmission line shielding analysis," *IEEE Trans. Power Del.*, vol. PWRD-2, no. 3, pp. 871-886, Apr. 1987.
- [17] P. Chowdhuri, and A. K. Kotapalli, "Significant parameters in estimating the striking distance of lightning strokes to overhead lines," *IEEE Trans. Power Del.*, vol. 4, no. 3, pp. 1970-1981, Jul. 1989.
- [18] F. A. M. Rizk, "Modelling of transmission line exposure to direct lightning strokes," *IEEE Trans. Power Del.*, vol. 5, no. 4, pp. 1983-1997, Oct. 1990.
- [19] L. Dellera and E. Garbagnati, "Lightning stroke simulation by means of the leader progression model," *IEEE Trans. Power Del.*, vol. 5, no. 4, pp. 2009-2029, Oct. 1990.
- [20] F. A. M. Rizk, "Modeling of lightning incidence to tall structures," *IEEE Trans. Power Del.*, vol. 9, no. 1, pp. 162-193, Jan. 1994.
- [21] N. I. Petrov and R. T. Waters, "Determination of the striking distance of lightning to earthed structures," *Proc. Roy. Soc., London A*, vol. 450, pp. 589-601, 1995.
- [22] N. I. Petrov, G. Petrova and R. T. Waters, "Determination of attractive area and collection volume of earthed structures," in *Proc. 25<sup>th</sup> Int. Conf. Lightning Protection*, Rhodes, Greece, 2000, pp. 374-379.
- [23] F. D'Alessandro and J. R. Gumley, "A collection volume method for the placement of air terminals for the protection of structures against lightning," *Elsevier J. Electrostat.*, vol. 50, pp. 279-302, 2001.
- [24] M. Beccera, V. Cooray and Z. A. Hartono, "Identification of Lightning Vulnerability Points on Complex Grounded Structures," *Elsevier J. Electrostat.*, vol. 65, pp. 562-570, 2007.
- [25] S. Ait-Amar and G. Berger, "Lightning protection modelling: Applications to revisited electrogeometrical model," in *Proc. 17<sup>th</sup> Int. Conf. Gas Discharges and their Application*, Cardiff, U.K., 2008, pp. 517-520.
- [26] R. T. Waters, "Lightning phenomena and protection systems," in *Advances in High Voltage Engineering*, ser. Inst. Elect. Eng. Power Energy, M. Haddad and D. Warne, Eds. London U.K.: Inst. Elect. Eng. 2004, vol. 40, pp. 107-114.
- [27] P. N. Mikropoulos and Th. E. Tsovilis, "Interception probability and shielding against lightning," *IEEE Trans. Power Del.*, in press.
- [28] P. N. Mikropoulos and Th. E. Tsovilis, "Interception probability and neighboring effects: Implications in shielding design against lightning," *IEEE Trans. Power Del.*, submitted.
- [29] P. N. Mikropoulos and Th. E. Tsovilis, "Striking distance and interception probability," *IEEE Trans. Power Del.*, vol. 23, no. 3, pp. 1571-1580, Jul. 2008.
- [30] CIGRE Working Group 33.01, "Guide to procedures for estimating the lightning performance of transmission lines," Technical Bulletin 63, Oct. 1991.
- [31] A. R. Hileman, "Shielding of transmission lines," *Insulation Coordination for Power Systems*, CRC Press, Taylor & Francis Group, New York, 1999, pp. 244-254.
- [32] T. Suzuki, K. Miyake and T. Shindo, "Discharge path model in model test of lightning strokes to tall mast," *IEEE Trans. Power App. Syst.*, vol. PAS-100, no. 7, pp. 3553-3562, Jul. 1981.
- [33] R. H. Golde, "The frequency of occurrence and the distribution of lightning flashes to transmission lines," *AIEE Trans.*, vol. 64, pp. 902-910, 1945.

- [34] G. Carrara and L. Thione, "Switching surge strength of large air gaps: A physical approach," *IEEE Trans. Power App. Syst.*, vol. 95, no. 2, pp. 512-524, Mar. 1976.
- [35] P. N. Mikropoulos and Th. E. Tsovilis, "Experimental investigation of the Franklin rod protection zone," in *Proc. 15<sup>th</sup> Int. Symp. High Voltage Eng.*, Ljubljana, Slovenia, 2007, paper 461, pp.1-5.
- [36] P. N. Mikropoulos and Th. E. Tsovilis, "Interception radius and shielding against lightning," *29<sup>th</sup> Int. Conf. Lightning Protection*, Uppsala, Sweden, 2008, paper 4-10, pp. 1-11.
- [37] J. He, Y. Tu, R. Zeng, J. B. Lee, S. H. Chang and Z. Guan, "Numeral analysis model for shielding failure of transmission line under lightning stroke," *IEEE Trans. Power Del.*, vol. 20, no. 2, pp. 815-822, Apr. 2005.
- [38] B. Vahidi, M. Yahyaabadi, M. R. B. Tavakoli and S. M. Ahadi, "Numeral analysis model for shielding failure of transmission line under lightning stroke," *IEEE Trans. Power Del.*, vol. 23, no. 4, pp. 2201-2206, Oct. 2008.
- [39] P. Pettersson and R. Eriksson, Discussion of [18].
- [40] P. N. Mikropoulos, Th. E. Tsovilis and T. Ananiadis, "The effect of an earthed object on the interception radius of the Franklin rod: An experimental investigation," *Med Power '08*, Thessaloniki, Greece, 2008, paper No. 77, pp. 1-6.

## VIII. BIOGRAPHIES



**Pantelis N. Mikropoulos** (M'06) was born in Kavala, Greece in 1967. He received the M.Eng. and Ph.D. degrees in electrical and computer engineering from Aristotle University of Thessaloniki (AUTH), Thessaloniki, Greece, in 1991 and 1995, respectively.

He held postdoctoral positions at AUTH and the University of Manchester, Manchester, U.K. He was Senior Engineer with Public Power Corporation SA, Athens, Greece. In 2003, he was elected Assistant Professor in High Voltage Engineering at AUTH, and since 2005, he has been the Director of the High Voltage Laboratory at AUTH. His research interests include the broad area of high-voltage engineering with an emphasis given on air and surface discharges, electric breakdown in general, and lightning protection.



**Thomas E. Tsovilis** (S'09) was born in Piraeus, Greece in 1983. He received the M.Eng. degree in electrical and computer engineering from Aristotle University of Thessaloniki, Thessaloniki, Greece, in 2005, where he is currently pursuing the Ph.D. degree in the High Voltage Laboratory.

His research is dedicated to lightning protection, including theoretical analysis and scale model experiments.